



Massachusetts Department of Environmental Protection  
Source Water Assessment and Protection (SWAP) Report  
for  
**Cambridge Water Department**

### What is SWAP?

The Source Water Assessment and Protection (SWAP) program, established under the federal Safe Drinking Water Act, requires every state to:

- inventory land uses within the recharge areas of all public water supply sources;
- assess the susceptibility of drinking water sources to contamination from these land uses; and
- publicize the results to provide support for improved protection.

### Susceptibility and Water Quality

Susceptibility is a measure of a water supply's potential to become contaminated due to land uses and activities within its recharge area.

A source's susceptibility to contamination does *not* imply poor water quality.

Water suppliers protect drinking water by monitoring for more than 100 chemicals, disinfecting, filtering, or treating water supplies, and using source protection measures to ensure that safe water is delivered to the tap.

Actual water quality is best reflected by the results of regular water tests. To learn more about your water quality, refer to your water supplier's annual Consumer Confidence Reports.

**Table 1: Public Water System Information**

<i>PWS Name</i>	Cambridge Water Department
<i>PWS Address</i>	250 Fresh Pond Parkway
<i>City/Town</i>	Cambridge Massachusetts
<i>PWS ID Number</i>	3049000
<i>Local Contact</i>	Chip Norton - Watershed Manager
<i>Phone Number</i>	(617) 349-4781

### Introduction

We are all concerned about the quality of the water we drink. Drinking water may be threatened by many potential contaminant sources, including storm runoff, road salting, and improper disposal of hazardous materials. Citizens and local officials can work together to better protect these drinking water sources.

#### **Purpose of this report:**

This report is a planning tool to support local and state efforts to improve water supply protection. By identifying land uses within water supply protection areas that may be potential sources of contamination, the assessment helps focus protection efforts on appropriate Best Management Practices (BMPs) and drinking water source protection measures.

Refer to Table 3 for Recommendations to address potential sources of contamination. Department of Environmental Protection (DEP) staff are available to provide information about funding and other resources that may be available to your community.


#### **This report includes the following sections:**

1. Description of the Water System
2. Land Uses within Protection Areas
3. Source Water Protection
4. Appendices

## Section 1: Description of the Water System

### What is a Watershed?

A watershed is the land area that catches and drains rainwater down-slope into a river, lake or reservoir. As water travels down from the watershed area it may carry contaminants from the watershed to the drinking water supply source. For protection purposes, watersheds are divided into protection Zones A, B and C.

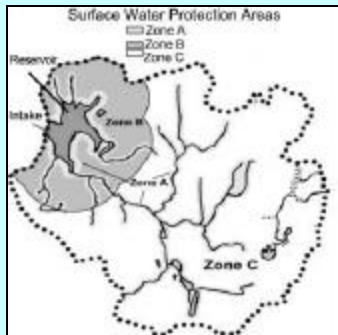

The water withdrawn from Fresh Pond is filtered, disinfected, pH-adjusted for corrosion control, and fluoridated for dental health. After treatment, the finished water is pumped to the Payson Park Reservoir in Belmont, where it awaits distribution throughout Cambridge.

<i>Source Name</i>	<i>Source ID</i>	<i>Susceptibility</i>
Hobbs Brook Reservoir - Lower	3049000-01S	High
Fresh Pond Reservoir	3049000-02S	High
Stony Brook Reservoir	3049000-03S	High
Hobbs Brook Reservoir - Upper	3049000-04S	High

The Cambridge water system consists of four sources with watersheds in several towns. The Hobbs Brook Upper Reservoir (04S) flows into the Hobbs Brook Lower Reservoir (01S), and is combined with water from the Stony Brook Reservoir (03S), then the combined water flows to the Fresh Pond Reservoir (02S).

The watershed for the Stony Brook Reservoir extends from Weston north into the town of Lincoln. The Hobbs Brook Reservoirs' watersheds include areas of Waltham, Lexington, and Lincoln. The functional watershed for the Fresh Pond Reservoir is now completely within the City of Cambridge, though it originally included areas of Watertown and Belmont. This smaller functional watershed is the result of stormwater drainage modifications that divert street runoff away from the reservoir. Please see the attached maps for more information about the reservoirs and their watersheds.

### Glossary Protection Zones

**Zone A:** is the most critical for protection efforts. It is the area 400 feet from the edge of the reservoir and 200 feet from the edge of the tributaries (rivers and/or streams) draining into it.

**Zone B:** is the area one-half mile from the edge of the reservoir but does not go beyond the outer edge of the watershed.

**Zone C:** is the remaining area in the watershed not designated as Zones A or B.

The attached map shows Zone A and your watershed boundary.

## Section 2: Land Uses in the Protection Areas

The protection areas for Cambridge are a mixture of residential, commercial, industrial, and forest land uses (refer to attached map for details). Land uses and activities that are potential sources of contamination are listed in Table 2.

### Key Land Uses and Protection Issues include:

1. Zone A Land Uses
2. Residential Land Uses
3. Transportation Corridors
4. Hazardous Materials Storage and Use
5. Presence of Oil or Hazardous Material Contamination Sites
6. Aquatic Wildlife
7. Protection Planning

The overall ranking of susceptibility to contamination for the system is high, based on the presence of at least one high threat land use within the water supply protection areas, as seen in Table 2.

**1. Zone A Land Uses** - The Zone A is the land area within 400 feet of a reservoir and 200 feet of its tributaries. The land uses and activities within the Zone A areas for Cambridge include: transportation corridors, above ground and underground storage tanks, commercial and industrial facilities, recreational activities, and aquatic wildlife. Public water systems are responsible for enforcing the prohibition of certain new or expanded land uses within the Zone A, as detailed in 310 CMR 22.20(b).

### Zone A Recommendations:

- ✓ Develop a Management Plan to minimize the impact that visitors will have within the Zone A of Fresh Pond Reservation.
- ✓ Actively monitor new or expanded land uses within the Zone A according to your watershed protocol submitted to DEP.
- ✓ To the extent possible, remove all activities from the Zone As to comply with DEP's Zone A requirements.
- ✓ Control stormwater and erosion within the Zone A.
- ✓ Control aquatic wildlife within the Zone A as necessary.
- ✓ Continue to work with local emergency response teams to practice containment of spills within the Zone A.
- ✓ Continue to conduct regular inspections of the Zone A for illegal dumping and spills.
- ✓ Install water supply protection area signs as needed around the Zone A.

**2. Residential Land Uses** – Approximately 35% of the watersheds consist of residential areas. Some of the areas have public sewers and some use septic systems. If managed improperly, activities associated with residential areas can contribute to drinking water contamination. Common potential sources of contamination include:

- **Septic Systems** - Improper disposal of household hazardous chemicals to septic systems is a potential source of contamination. If septic systems fail or are not properly maintained they can be a potential source of microbial contamination.
- **Household Hazardous Materials** - Hazardous materials may include automotive wastes, paints, solvents, pesticides, fertilizers, and other substances. Improper use, storage, and disposal of chemical products used in homes are potential sources of contamination.

- **Heating Oil Storage** - If managed improperly, Underground and Aboveground Storage Tanks (USTs and ASTs) can be potential sources of contamination due to leaks or spills of the fuel oil they store.

### Residential Land Use Recommendations:

- ✓ Work cooperatively with Boards of Health to develop an inventory of septic systems in Lincoln and Weston.
- ✓ Educate residents on best management practices (BMPs) for protecting water supplies. Distribute the fact sheet "Residents Protect Drinking Water" available in Appendix A and on [www.mass.gov/dep/brp/dws/protect.htm](http://www.mass.gov/dep/brp/dws/protect.htm), which provides BMPs for common residential issues.
- ✓ Work with planners to control new residential developments in the water supply protection areas.
- ✓ Promote BMPs for stormwater management and pollution controls.

**3. Transportation Corridors** - Route 128/I-95, Route 2, Route 2A, and Route 20 run through the Zone A areas. Local roads are common throughout the watersheds. Roadway construction, maintenance, and typical highway use can all be potential sources of contamination. Accidents can lead to spills of gasoline and other potentially dangerous transported chemicals. Roadways are frequent sites for illegal dumping of hazardous or other potentially harmful wastes. De-icing salt, automotive chemicals and other debris on roads are picked up by stormwater and wash in to catch basins.

### Benefits of Source Protection

Source Protection helps protect public health and is also good for fiscal fitness:

- Protects drinking water quality at the source
- Reduces monitoring costs through the DEP Waiver Program
- Treatment can be reduced or avoided entirely, saving treatment costs
- Prevents costly contamination clean-up
- Preventing contamination saves costs on water purchases, and expensive new source development

Contact your regional DEP office for more information on Source Protection and the Waiver Program.

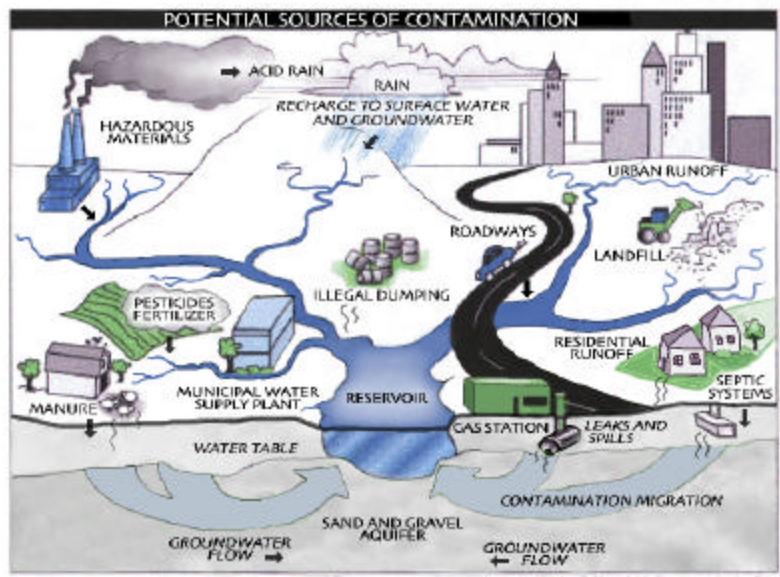


Figure 1: Sample watershed with examples of potential sources of contamination

Railroad tracks run through the water supply protection areas. Rail corridors serving passenger or freight trains are potential sources of contamination due to chemicals released during normal use, track maintenance, and accidents. Accidents can release spills of train engine fluids and commercially transported chemicals.

**Transportation Corridor Recommendations:**

- ✓ Continue to work cooperatively with the Massachusetts Highway Department on a hazardous materials management plan, on a salt use reduction strategy, and on the implementation of structural and maintenance of BMP.
- ✓ Work with the Towns and State to have catch basins inspected, maintained, and cleaned on a regular schedule. Street sweeping reduces the amount of potential contaminants in runoff.
- ✓ Continue to work with local emergency response teams to ensure that any spills within the watersheds can be effectively contained.
- ✓ Review storm drainage maps with emergency response teams. Work with town officials to investigate mapping options such as the upcoming Phase II Stormwater Rule requiring some communities to complete stormwater mapping.
- ✓ Work with local officials during their review of the railroad right of way Yearly Operating Plans to ensure that water supplies are protected during vegetation control.


**What are "BMPs?"**

Best Management Practices (BMPs) are measures that are used to protect and improve surface water and groundwater quality. BMPs can be structural, such as oil & grease trap catch basins, nonstructural, such as hazardous waste collection days or managerial, such as employee training on proper disposal procedures.

**4. Hazardous Materials Storage and Use** – Six percent of the land area within the watersheds is commercial or industrial land uses. Many small businesses and industries use hazardous materials, produce hazardous waste products, and/or store large quantities of hazardous materials in UST/AST. If hazardous materials are improperly stored, used, or disposed, they become potential sources of contamination. Hazardous materials should never be disposed of to a septic system or floor drain leading directly to the ground.

**Hazardous Materials Storage and Use Recommendations:**

- ✓ Continue to educate local businesses on best management practices for protecting water supplies. Distribute the fact sheet “Businesses Protect Drinking Water” available in Appendix A and on [www.mass.gov/dep/brp/dws/protect.htm](http://www.mass.gov/dep/brp/dws/protect.htm), which provides BMP’s for common business issues.
- ✓ Work with local businesses to register those facilities that are unregistered generators of hazardous waste or waste oil. Partnerships between businesses, water suppliers, and communities enhance successful public drinking water protection practices.

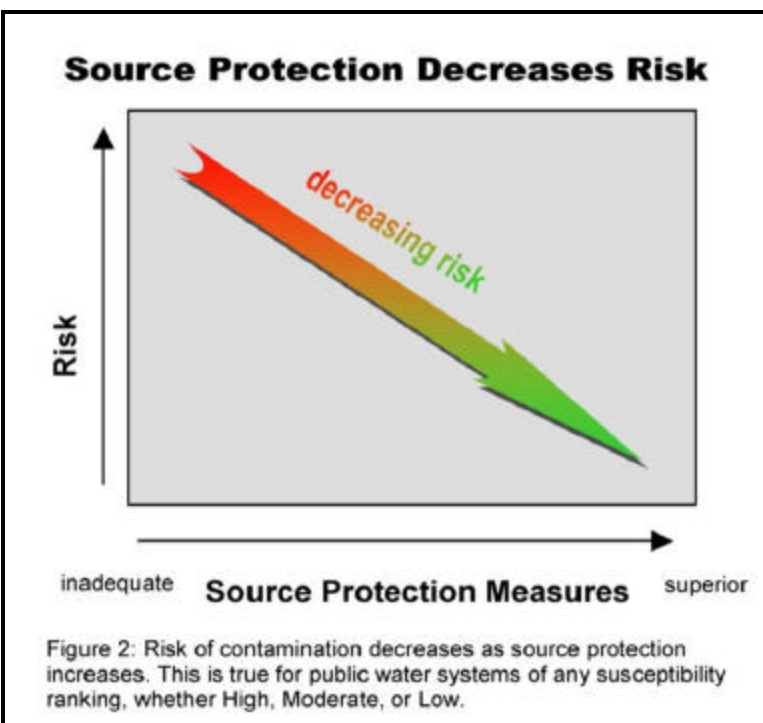

- ✓ Educate local businesses on Massachusetts floor drain requirements. See brochure “Industrial Floor Drains” for more information.

**5. Presence of Oil or Hazardous Material Contamination Sites** – The watersheds contain DEP Tier Classified Oil and/or Hazardous Material Release Sites indicated on the maps as Release Tracking Numbers 3-0016793, 30002382, 30001320, 30018589, 3-0002920, 3-0010293, 3-0000582, 3-0013311, 30001000, 30001213, 30011633, and 3-0003920. Outside of the functional watershed for Fresh Pond Reservoir, but within the larger natural watershed are the DEP Tier Classified Oil and/or Hazardous Material Release Sites indicated on the map as 3-0018094, 3-0000269, 3-0002594, 3-0013222, 30000089, 30015303, 30000959, 3-0019196, 3-0013583, 3-0013797, 3-0016604, and 3-0002177. Refer to the attached map and Appendix 3 for more information.

### Potential Source of Contamination vs. Actual Contamination

The activities listed in Table 2 are those that typically use, produce, or store contaminants of concern, which, if managed improperly, are potential sources of contamination (PSC).

It is important to understand that a release may never occur from the potential source of contamination provided facilities are using best management practices (BMPs). If BMPs are in place, the actual risk may be lower than the threat ranking identified in Table 2. Many potential sources of contamination are regulated at the federal, state and/or local levels, to further reduce the risk.

**Table 2: Land Use in the Watersheds**

Activities	Quantity	Threat	Source #	Potential Source of Contamination
<b>Agricultural</b>				
Fertilizer Storage or Use	Many	M	02S, 03S, 04S	Fertilizers: leaks, spills, improper handling, or over-application
Livestock Operations	Several	H	03S, 04S	Manure (microbial contaminants): improper handling
Landscaping	Many	M	All	Fertilizers and pesticides: leaks, spills, improper handling, or over-application
Manure Storage or Spreading	Several	H	03S, 04S	Manure (microbial contaminants): improper handling
Nurseries	2	M	04S	Fertilizers, pesticides, and other chemicals: leaks, spills, improper handling, or over-application
Pesticide Storage or Use	Many	H	02S, 03S, 04S	Pesticides: leaks, spills, improper handling, or over-application
<b>Commercial</b>				
Auto Repair Shops	Several	M	All	Automotive fluids, vehicle paints and solvents: spills, leaks, or improper handling
Car/Truck/Bus Washes	1	L	03S	Vehicle wash water, soaps, oils, greases, metals, and salts: improper management
Gas Stations/ Service Stations	Several	M	All	Automotive fluids and fuels: spills, leaks, or improper handling or storage
Bus and Truck Terminals	1	M	04S	Fuels and maintenance chemicals: spills, leaks, or improper handling
Golf Courses	2	M	02S, 03S	Fertilizers or pesticides: over-application or improper handling
Junk Yards and Salvage Yards	1	H	03S	Automotive chemicals, wastes, and batteries: spills, leaks, or improper handling
Laundromats	2	L	01S, 04S	Wash water: improper management



**Table 2: Land Use in the Watersheds**

<b>Activities</b>	<b>Quantity</b>	<b>Threat</b>	<b>Source #</b>	<b>Potential Source of Contamination</b>
<b>Commercial (cont'd)</b>				
Medical Facilities	1	L	01S	Biological, chemical, and radioactive wastes: spills, leaks, or improper handling or storage
Nursing Homes	1	L	01S	Microbial contaminants: improper management
Paint Shops	1	M	04S	Paints, solvents, other chemicals: spills, leaks, or improper handling or storage
Photo Processors	1	M	03S	Photographic chemicals: spills, leaks, or improper handling or storage
Printer and Blueprint Shops	2	M	01S, 03S	Printing inks and chemicals: spills, leaks, or improper handling or storage
Railroad Tracks and Yards	1	H	01S, 03S	Herbicides: over-application or improper handling; fuel storage, transported chemicals, and maintenance chemicals: leaks or spills
Repair Shops (Engine, Appliances, Etc.)	2	M	01S, 02S	Engine fluids, lubricants, and solvents: spills, leaks, or improper handling or storage
Research Laboratories	5	M	01S, 03S	Laboratory chemicals and wastes: spills, leaks, or improper handling or storage
<b>Industrial</b>				
Chemical Manufacture or Storage	1	H	03S	Chemicals and process wastes: spills, leaks, or improper handling or storage
Industry/Industrial Parks	Several	H	01S, 02S, 03S	Industrial chemicals and metals: spills, leaks, or improper handling or storage
<b>Residential</b>				
Fuel Oil Storage (at residences)	Many	M	All	Fuel oil: spills, leaks, or improper handling
Lawn Care/Gardening	Many	M	All	Pesticides: over-application or improper storage and disposal
Septic Systems/Cesspools	Many	M	All	Hazardous chemicals: microbial contaminants, and improper disposal
<b>Miscellaneous</b>				
Aquatic Wildlife	Many	H	All	Microbial contaminants
Clandestine Dumping	Frequent	H	All	Debris containing hazardous materials or wastes
Combined Sewer Overflows	Several	H	All	Microbial and non-microbial contaminants including industrial wastewater; improper disposal of hazardous wastes

**Table 2: Land Use in the Watersheds**

Activities	Quantity	Threat	Source #	Potential Source of Contamination
<b>Miscellaneous</b>				
Composting Facilities	1	M	02S, 03S	Organic material, animal waste, and runoff: storage and improper handling
Landfills and Dumps	1	H	03S	Seepage of leachate (Note - capped landfill)
Road and Maintenance Depots	2	M	03S, 04S	Deicing materials, automotive fluids, fuel storage, and other chemicals: spills, leaks, or improper handling or storage
Schools, Colleges, and Universities	2	M	03S, 04S	Fuel oil, laboratory, art, photographic, machine shop, and other chemicals: spills, leaks, or improper handling or storage
Snow Dumps	Several	M	All	Melt water containing de-icing and other chemicals from roads and parking lots: improper handling
Transportation Corridors	Several	H	All	Fuels and other hazardous materials: accidental leaks or spills; pesticides: over-application or improper handling
Underground Storage Tanks	Many	M	All	Stored materials: spills, leaks, or improper handling
Utility Substation Transformers	1	M	04S	Chemicals and other materials including PCBs: spills, leaks, or improper handling
Waste Transfer/ Recycling Stations	1	M	03S	Water contacting waste materials: improper management, seepage, and runoff
<b>Notes:</b>				
<ol style="list-style-type: none"> <li>1. When specific potential contaminants are not known, typical potential contaminants or activities for that type of land use are listed. Facilities within the watershed may not contain all of these potential contaminant sources, may contain other potential contaminant sources, or may use Best Management Practices to prevent contaminants from reaching drinking water supplies.</li> <li>2. For more information on regulated facilities, refer to Appendix B: Regulated Facilities within the Water Supply Protection Area information about these potential sources of contamination.</li> <li>3. For information about Oil or Hazardous Materials Sites in your protection areas, refer to Appendix C: Tier Classified Oil and/or Hazardous Material Sites.</li> </ol> <p>* <b>THREAT RANKING</b> - The rankings (high, moderate or low) represent the relative threat of each land use compared to other PSCs. The ranking of a particular PSC is based on a number of factors, including: the type and quantity of chemicals typically used or generated by the PSC; the characteristics of the contaminants (such as toxicity, environmental fate and transport); and the behavior and mobility of the pollutants in soils and groundwater.</p>				

**Oil or Hazardous Material Contamination Sites Recommendation:**

- ✓ Monitor progress on any ongoing remedial action conducted for the known oil or contamination sites.

**6. Aquatic Wildlife** - Birds, particularly gulls, are attracted to large open bodies of water. Birds may increase coliform levels through the release of fecal matter into the water and may carry other bacteria and viruses. Beaver and muskrat may introduce the pathogens Giardia and Cryptosporidium into water through fecal matter. Because of their constant contact with the water, these aquatic mammals represent a potential threat to drinking water reservoirs. Appendix A contains a DEP fact sheet titled *What You Need To Know About Microbial Contamination*.

**Aquatic Wildlife Recommendations:**

- ✓ Monitor wildlife populations in and around reservoirs.
- ✓ Where necessary, discourage and control aquatic wildlife. See <http://mass.gov/dep/brp/dws/protect.htm> for guidance and permits.

**7. Protection Planning** - Protection planning protects drinking water by managing the land area that supplies water to a reservoir. Currently, the watershed towns do not have water supply protection controls that meet DEP's Surface Water Protection regulations 310 CMR 22.20 (b) and (c). A Surface Water Supply Protection Plan coordinates community efforts, identifies protection strategies, establishes a timeframe for implementation, and provides a forum for public participation. There are resources available to help communities develop a plan for protecting drinking water supply reservoirs.

**Protection Planning Recommendations:**

- ✓ Complete the City's Surface Water Supply Protection Plan. Refer your protection team to <http://mass.gov/dep/brp/dws/protect.htm> for a copy of DEP's guidance, "Developing a Surface Water Supply Protection Plan".
- ✓ Encourage watershed towns to adopt controls that meet 310 CMR 22.20 (b) and (c). For more information on DEP land use controls see <http://mass.gov/dep/brp/dws/protect.htm>.
- ✓ Continue to work with town boards to review and provide recommendations on proposed development within your water supply protection areas. To obtain information on build-out analyses for the towns, see the Executive Office of Environmental Affairs' community preservation web site, <http://commpres.env.state.ma.us/>.

Other land uses and activities within the Protection areas that are potential sources of contamination are included in Table 2. Refer to Appendix B for more information about these land uses. Identifying potential sources of contamination is an important initial step in protecting your drinking water sources. Further local investigation will provide more in-depth information and may identify new land uses and activities that are potential sources of contamination. Once potential sources of contamination are identified, specific recommendations like those below should be used to better protect your water supply.

**Section 3: Source Water Protection Conclusions and Recommendations**

**Current Land Uses and Source Protection:**

As with many water supply protection areas, the system watersheds contain potential sources of contamination. However, source protection measures reduce the risk of actual contamination, as illustrated in Figure 2.

Cambridge Water Department is commended for taking an active role in promoting source protection measures through:

- Working cooperatively with watershed towns on emergency response and stormwater management.
- Placing spill kits at strategic points within the watersheds.
- Actively monitoring source water quality throughout the watersheds and using the data to target source protection.
- Working cooperatively with businesses within the watersheds to encourage source protection.
- Adopting the Fresh Pond Master Plan, which includes long term source protection measures.
- Dedicating staff resources to inspections, public education, and coordinating source protection efforts.

**Top 5 Reasons to Develop a Local Surface Water Protection Plan**

- ➊ Reduces Risk to Human Health
- ➋ Cost Effective! Reduces or Eliminates Costs Associated With:
  - ◆ Increased monitoring and treatment
  - ◆ Water supply clean up and remediation
  - ◆ Replacing a water supply
  - ◆ Purchasing water
- ➌ Supports municipal bylaws, making them less likely to be challenged
- ➍ Ensures clean drinking water supplies for future generations
- ➎ Enhances real estate values - clean drinking water is a local amenity. A community known for its great drinking water in a place people want to live and businesses want to locate.



**Table 3: Current Protection and Recommendations**

<b>Protection Measures</b>	<b>Status</b>	<b>Recommendations</b>
<b>Zone A</b>		
Is the Zone A posted with “Public Drinking Water Supply” Signs?	<b>YES</b>	Additional economical signs are available from the Northeast Rural Water Association (802) 660-4988.
Is the Zone A regularly inspected?	<b>YES</b>	Continue daily inspections of drinking water protection areas.
Are water supply-related activities the only activities within the Zone A?	<b>NO</b>	Continue monitoring non-water supply activities in Zone As.
Are Zone A storm drain locations identified?	<b>YES</b>	Continue to work with local emergency response teams and businesses on Zone A storm drainage.
<b>Municipal Controls</b> (Zoning Bylaws, Health Regulations, and General Bylaws)		
Do the watershed communities have Surface Water Protection Controls that meet 310 CMR 22.20C?	<b>NO</b>	Work with neighboring municipalities to include the watershed in their protection controls. Refer to <a href="http://www.state.ma.us/dep/brp/dws/">www.state.ma.us/dep/brp/dws/</a> for model bylaws, health regulations, and current regulations.
<b>Planning</b>		
Does the PWS have a local surface water supply protection plan?	<b>NO</b>	Complete your surface water supply protection plan in 2003. Follow “Developing a Local Surface Water Supply Protection Plan” available at: <a href="http://www.state.ma.us/dep/brp/dws/">www.state.ma.us/dep/brp/dws/</a> .
Does the PWS have a formal “Emergency Response Plan” to deal with spills or other emergencies?	<b>YES</b>	Supplement plan by developing joint emergency response plans with fire departments, Boards of Health, DPWs, and local and state emergency officials. Coordinate emergency response drills with local teams.
Does the municipality have a watershed protection committee?	<b>YES</b>	Reactivate committees; include representatives from citizens’ groups, neighboring communities, and the business community.
Does the Board of Health conduct inspections of commercial and industrial activities?	<b>YES/NO</b>	In Cambridge, yes. Encourage watershed communities to inspect commercial and industrial facilities, especially those that may have floor drains that do not lead to sanitary sewers or tight tanks. For more guidance see “Hazardous Materials Management: A Community’s Guide” at <a href="http://www.state.ma.us/dep/brp/dws/files/hazmat.doc">www.state.ma.us/dep/brp/dws/files/hazmat.doc</a>
Does the PWS provide watershed protection education?	<b>YES</b>	Aim additional efforts at commercial, industrial and municipal uses within the watershed.

### Source Protection Recommendations:

To better protect the sources for the future:

- ✓ Develop and implement a Surface Water Supply Protection Plan.
- ✓ Work cooperatively with Boards of Health to develop an inventory of septic systems in Lincoln and Weston.
- ✓ Work with businesses and others who have landscaped areas in the watersheds to encourage BMPs for the use of fertilizer and pesticide.
- ✓ Continue to partner with local businesses to ensure the proper storage, handling, and disposal of hazardous materials.
- ✓ Educate residents on ways they can help you to protect drinking water sources.
- ✓ Work with emergency response teams to ensure cooperation on responding to spills or accidents.
- ✓ Monitor progress on any ongoing remedial action conducted for the known oil or contamination sites.
- ✓ Continue to inspect the Zone A areas regularly, and when feasible, remove prohibited non-water supply activities.

### Conclusions:

These recommendations are only part of your ongoing local drinking water source protection. Additional source protection recommendations are listed in Table 3, the Key Issues above and Appendix A.

DEP staff, informational documents, and resources are available to help you build on this SWAP report as you continue to improve drinking water protection in your community. The Department's Source Protection Grant Program provides funds to assist public water suppliers in addressing water supply source protection through local projects. Protection recommendations discussed in this document may be eligible for funding under the Grant Program. Please note: each spring DEP posts a new Request for Response (RFR) for the grant program.

Other grants and loans are available through the Drinking Water State Revolving Loan Fund, the Clean Water State Revolving Fund, and other sources. For more information on grants and loans, visit the Bureau of Resource Protection's Municipal Services web site at: <http://mass.gov/dep/brp/mf/mfpubs.htm>.

The assessment and protection recommendations in this SWAP report are provided as a tool to encourage community discussion, support ongoing source protection efforts, and help set local drinking water protection priorities. Citizens and community officials should use this SWAP report to spur discussion of local drinking water protection measures. The water supplier should supplement this SWAP report with local information on potential sources of contamination and land uses. Local information should be maintained and updated periodically to reflect land use changes in the watershed. Use this information to set priorities, target inspections, focus education efforts, and to develop a long-term drinking water source protection plan.

### Section 4: Appendices

- A. Protection Recommendations
- B. Regulated Facilities within the Water Supply Protection Area
- C. Table of Tier Classified Oil and/or Hazardous Material Sites within the Water Supply Protection Areas
- D. Additional Documents on Source Protection

### Additional Documents:

To help with source protection efforts, more information is available by request or online at [www.state.ma.us/dep/brp/dws](http://www.state.ma.us/dep/brp/dws) including:

1. Water Supply Protection Guidance Materials such as model regulations, Best Management Practice information, and general water supply protection information.
2. MA DEP SWAP Strategy
3. Land Use Pollution Potential Matrix
4. Draft Land/Associated Contaminants Matrix

### For More Information

Contact Anita Wolovick in DEP's Wilmington Office at (978) 661-7768 for more information and assistance on improving current protection measures.

Copies of this report have been provided to the public water supplier and town boards.

**APPENDIX A: DEP PERMITTED FACILITIES WITHIN CAMBRIDGE WATER SUPPLY PROTECTION AREAS**

<b>DEP FACILITY NUMBER</b>	<b>FACILITY NAME</b>	<b>STREET ADDRESS</b>	<b>TOWN</b>	<b>PERMITTED ACTIVITY</b>	<b>ACTIVITY CLASS</b>
337567	LORDS CLEANERS	155 BELMONT ST.	BELMONT	HANDLR	VERY SMALL QUANTITY GENERATOR
337567	LORDS CLEANERS	155 BELMONT ST.	BELMONT	PLANT	BELOW AQ REGULATED THRESHOLDS
295101	NANOR PRINTS INC	279 BELMONT ST.	BELMONT	DISCH	MWRA SEWER CONNECTION
31208	PROSPECT AUTO BODY INC	259 BELMONT ST.	BELMONT	HANDLR	VERY SMALL QUANTITY GENERATOR
209185	A AND E SERVICE STATION INC	199 CONCORD AVE.	CAMBRIDGE	FULDSP	FUEL DISPENSER STAGEII
297033	ADAPTIVE OPTICS ASSOCIATES	54 SMITH PL.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
32734	BOLT BERANEK & NEWMAN INC	10 MOULTON ST.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
35519	CAMBRIDGE WATER DEPARTMENT	250 FRESH POND PKWY	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
35519	CAMBRIDGE WATER DEPT CITY OF	250 FRESH POND PKWY	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
291291	CAMBRIDGE WATER PURIFICATION PLANT	250 FRESH POND PKWY	CAMBRIDGE	SURFAC	SURFACEWATER MAJOR
216549	COMPLETE PHOTO SERVICE INC	703 MOUNT AUBURN ST.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
27359	COMSTOCK & WESCOTT INC	765 CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
320671	CURIS INC	61 MOULTON ST.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
320671	CURIS INC	61 MOULTON ST.	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR
292784	CURIS INC	45 MOULTON ST.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
325887	CVS #1022	211 ALEWIFE BROOK PKWY	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
338532	DIAGNOSTIC CENTER THE	575 MOUTN AUBURN ST.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
356137	E INK CORPORATION	733 CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
30134	EURAUTO SPORTS CENTER INC	57 NEW ST.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
282182	EUROPEAN COLLISION CENTER	45 NEW ST.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
209463	FRESH POND GAS	480 CONCORD AVE.	CAMBRIDGE	FULDSP	FUEL DISPENSER STAGEII
209463	FRESH POND GAS	480 CONCORD AVE.	CAMBRIDGE	HANDLR	NON-NOTIFIER HW FAC THAT IS SUBJ TO REGS BUT NOT PERMITTED
136286	FRESH POND GULF SERVICE CENTER	260 LEXINGTON AVE.	CAMBRIDGE	FULDSP	FUEL DISPENSER STAGEII
308183	GENETICS INSTITUTE LLC	735 CONCORD AVE.	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR
308183	GENETICS INSTITUTE LLC	735 CONCORD AVE.	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR - WASTE OIL/PCBS ONLY

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
308183	GENETICS INSTITUTE LLC	735 CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
308183	GENETICS INSTITUTE LLC	735 CONCORD AVE.	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR
326701	GEOCHRON LABORATORIES	711 CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
265931	HARVARD UNIVERSITY OBSERVATORY	160 CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
265931	HARVARD UNIVERSITY OBSERVATORY	160 CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR - WASTE OIL/PCBS ONLY
320616	HI TECH AUTO BODY INC	51 NEW ST.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
130980	HYPERION CATALYSIS INTERNATIONAL INC	40 SMITH PL.	CAMBRIDGE	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
130980	HYPERION CATALYSIS INTERNATIONAL INC	38 SMITH ST.	CAMBRIDGE	TURRPT	LARGE QUANTITY TOXIC USER
130980	HYPERION CATALYSIS INTERNATIONAL INC	38 SMITH PL.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
309505	INFIMED INC	767C CONCORD AVE., SUITE 100	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR
309505	INFIMED INC	767C CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
309505	INFIMED INC	767C CONCORD AVE., SUITE 100	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR - WASTE OIL/PCBS ONLY
283539	KRUEGER ENTERPRISES INC	711 CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION



DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
335507	MICROCHIPS INC	45 SPINELLI WAY	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
335507	MICROCHIPS INC	45 SPINELLI WAY	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
367516	MOBIL 13208	343 FRESH POND PKWY	CAMBRIDGE	FULDSP	FUEL DISPENSER STAGEII
178046	MOBIL OIL CORP SS 175	343 FRESH POND PKWY	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
178046	MOBIL OIL CORP SS 175	343 FRESH POND PKWY	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR - WASTE OIL/PCBS ONLY
338491	NEW OBJECTIVE INC	763 D CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
338069	NOVIRIO PHARMACEUTICALS INC	763E CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
338069	NOVIRIO PHARMACEUTICALS INC	763E CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR - WASTE OIL/PCBS ONLY
205788	OMNIGENE BIOPRODUCTS INC	763D CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
205788	OMNIGENE BIOPRODUCTS INC	763D CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
287349	PANGAEA PHARMACEUTICALS	763 EAST CONCORD ST.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
360890	PARALLEL SOLUTIONS INC	763D CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
360890	PARALLEL SOLUTIONS INC	763D CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR - WASTE OIL/PCBS ONLY

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
36143	PROTEIN ENGINEERING CORP	765 CONCORD AVE.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
51903	SANCTA MARIA NURSING FACILITY	799 CONCORD AVE.	CAMBRIDGE	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
338512	SCHATZKI ASSOCIATES INC	725 CONCORD AVE.	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
325388	SHELL 137725	603 CONCORD AVE.	CAMBRIDGE	FULDSP	FUEL DISPENSER STAGEII
126697	SUNOCO #0014-2877	515 CONCORD AVE.	CAMBRIDGE	FULDSP	FUEL DISPENSER STAGEII
326418	TRANS KARYOTIC THERAPIES	205 ALEWIFE BROOK PKWY	CAMBRIDGE	HANDLR	SMALL QUANTITY GENERATOR
326418	TRANS KARYOTIC THERAPIES INC	205 ALEWIFE BROOK PKWY	CAMBRIDGE	DISCH	MWRA SEWER CONNECTION
33089	VERIZON NEW ENGLAND INC	75 SMITH PL.	CAMBRIDGE	HANDLR	VERY SMALL QUANTITY GENERATOR
375112	128 LEXINGTON GAS	690 MARRETT RD.	LEXINGTON	FULDSP	FUEL DISPENSER STAGEII
375112	128 LEXINGTON GAS DBA	690 MARRETT RD.	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
375804	AURIGENE DISCOVERY TECHNOLOGIES INC	99 HAYDEN AVE.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
375804	AURIGENE DISCOVERY TECHNOLOGIES INC	99 HAYDEN AVE.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
375804	AURIGENE DISCOVERY TECHNOLOGIES INC	99 HAYDEN AVE.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
375804	AURIGENE DISCOVERY TECHNOLOGIES INC	99 HAYDEN AVE.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
343656	BAE SYSTEMS IEWS	2 FORBES RD.	LEXINGTON	TURRPT	LARGE QUANTITY TOXIC USER
343656	BAE SYSTEMS INFORMATION & ELECTRONIC SYS	2 FORBES RD.	LEXINGTON	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
343656	BAE SYSTEMS INFORMATION & ELECTRONIC SYS	2 FORBES RD.	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
343656	BAE SYSTEMS INFORMATION & ELECTRONIC SYS	2 FORBES RD.	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
343656	BAE SYSTEMS INFORMATION & ELECTRONIC SYS	2 FORBES RD.	LEXINGTON	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
343656	BAE SYSTEMS INFORMATION & ELECTRONIC SYS	2 FORBES RD.	LEXINGTON	PLANT	AQ SYNTHETIC MINOR W/RESTR PTE < OR = 25% OF MAJ
343656	BAE SYSTEMS INFORMATION & ELECTRONIC SYS	2 FORBES RD.	LEXINGTON	DISCH	MWRA SEWER CONNECTION
334052	CIRCE BIOMEDICAL INC	99 HAYDEN AVE.	LEXINGTON	DISCH	MWRA SEWER CONNECTION
334052	CIRCE BIOMEDICAL INC	99 HAYDEN AVE.	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
29171	COLLABORATIVE RESEARCH INC	128 SPRING ST.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
130974	LEDGEMONT RESEARCH PARK ASSOCIATES	128 SPRING ST.	LEXINGTON	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
246198	LEXINGTON FAMILY CHIROPRACTIC	120 R SCHOOL ST.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
32699	MA DEPARTMENT OF PUBLIC WORKS	RTE 2A	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
32699	MA DEPARTMENT OF PUBLIC WORKS	RTE 2A	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
32699	MA DEPARTMENT OF PUBLIC WORKS	RTE 2A	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
32699	MA DEPARTMENT OF PUBLIC WORKS	RTE 2A	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
30796	MINUTEMAN REG VOC TECH SCH DIST	758 MARRETT RD.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
34099	MINUTEMAN TOOL REPAIR INC	12 BICENTENNIAL DR.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
317348	PHYLOS INC	128 SPRING ST.	LEXINGTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
317348	PHYLOS INC	128 SPRING ST.	LEXINGTON	DISCH	MWRA SEWER CONNECTION
130977	RAYTHEON COMPANY	141 SPRING ST.	LEXINGTON	FULDSP	FUEL DISPENSER STAGEII
177004	RAYTHEON COMPANY	131 SPRING ST.	LEXINGTON	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
177004	RAYTHEON COMPANY	131 SPRING ST.	LEXINGTON	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
130977	RAYTHEON COMPANY EXECUTIVE OFFICES	141 SPRING ST.	LEXINGTON	PLANT	RES APPLICATION APPROVED
135839	DOHERTYS GARAGE INC	161 LINCOLN RD.	LINCOLN	FULDSP	FUEL DISPENSER

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
39960	LINCOLN TRANSFER STATION	RTE 2A/MILL ST.	LINCOLN	TRSTN	SMALL TRANSFER STATION
246226	LINCOLN WOODS COOPERATIVE HOUSING	50 WELLS RD.	LINCOLN	GROUND	GROUNDWATER MINOR
286229	PUBLIC SAFETY COMPLEX	169 LINCOLN RD.	LINCOLN	APPR	INDUSTRIAL SEWER WASTE WATER
135840	TRACEYS SERVICE STATION INC	131 CAMBRIDGE TURNPIKE	LINCOLN	FULDSP	FUEL DISPENSER
117679	ACTRONICS INCORPORATED	166 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
117679	ACTRONICS INCORPORATED	166 BEAR HILL RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
334824	AFFILIATED BUILDING SERVICES INC	1265 MAIN ST. W7	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
334824	AFFILIATED BUILDING SERVICES INC	1265 MAIN ST. W7	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR WASTE OIL/PCBS
334824	AFFILIATED BUILDING SERVICES INC	1265 MAIN ST. W7	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR WASTE OIL/PCBS
334824	AFFILIATED BUILDING SERVICES INC	1265 MAIN ST. W7	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
251747	AIRBORNE RESEARCH	260 BEAR HILL RD.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251747	AIRBORNE RESEARCH	269 BEAR HILL RD.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251747	AIRBORNE RESEARCH	260 BEAR HILL RD.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS



DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
251747	AIRBORNE RESEARCH	260 BEAR HILL RD.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
282234	AIRFLOW RESEARCH AND MANUFACTURING CORP	101 FIRST AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
314123	ALGONQUIN GAS TRANSMISSIONCO VALVE J11A	686 LINCOLN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
319432	ALTHEXIS COMPANY INC THE	1365 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
319432	ALTHEXIS COMPANY INC THE	1365 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
319432	ALTHEXIS COMPANY INC THE	1365 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
319432	ALTHEXIS COMPANY INC THE	1365 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
319432	ALTHEXIS COMPANY INC THE	1365 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
319432	ALTHEXIS COMPANY INC THE	1365 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
305434	ASTRAZENECA PHARMACEUTICALS LP	35 GATEHOUSE DR.	WALTHAM	PLANT	AQ SYNTHETIC MINOR W/RESTR BUT <OR= 50% OF MAJ
305434	ASTRAZENECA PHARMACEUTICALS LP	35 GATEHOUSE DR.	WALTHAM	DISCH	MWRA SEWER CONNECTION
305434	ASTRAZENECA PHARMACEUTICALS LP	35 GATEHOUSE DR.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
251754	AURORA TECH	167 SECOND AVE.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
251754	AURORA TECH	176 SECOND AVE.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251754	AURORA TECH	176 SECOND AVE.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
251754	AURORA TECH	176 SECOND AVE.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
251761	BAY STATE FLORIST	285 BEAR HILL RD.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251761	BAY STATE FLORIST	285 BEAR HILL RD.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
251761	BAY STATE FLORIST	285 BEAR HILL RD.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251761	BAY STATE FLORIST	285 BEAR HILL RD.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
26830	BERGERON CO INC	1474 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
360759	BEYOND GENOMICS	40 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
360759	BEYOND GENOMICS	40 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
360759	BEYOND GENOMICS	40 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
360759	BEYOND GENOMICS	40 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
282399	BIO MEDICAL APPLICATIONS OF WALTHAM	1254 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
332042	BOSTON PROPERTIES	50 JONES RD.	WALTHAM	SURFAC	SURFACEWATER MAJOR
318655	BOSTON PROPERTIES LIMITED PARTNERSHIP	1601 TRAPELO RD.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
32483	CAMBEX CORP	360 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
133517	CENTERLESS GRINDING CO INC	25 JONES RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
136352	CLAUDES SERVICE STATION INC	1420 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
33467	COCA COLA	80 SECOND AVE.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE<MAJ & >50% OF MAJ
33467	COCA COLA BOTTLING CO OF NEW ENGLAND	80 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
337849	CONFLUENT SURGICAL INC	101A FIRST AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
295728	COSTCO WHOLESALE # 308	520 WINTER ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
295728	COSTCO WHOLESALE # 308	520 WINTER ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
295728	COSTCO WHOLESALE # 308	520 WINTER ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
295728	COSTCO WHOLESALE # 308	520 WINTER ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
339946	CTC COMMUNICATIONS CORPORATION	115 SECOND AVE.	WALTHAM	PLANT	AQ SYNTHETIC MINOR W/RESTR BUT <OR= 50% OF MAJ

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
207307	CTI CRYOGENICS	266 2ND AVE.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
316226	DATA ASSOCIATES INC	280 BEAR HILL RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
30341	DICK A B	130 THIRD AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
131799	EASTERN REPRODUCTION	1250 MAIN ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
131799	EASTERN REPRODUCTION	1250 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
131799	EASTERN REPRODUCTION CORPORATION	1250 MAIN ST.	WALTHAM	TURRPT	LARGE QUANTITY TOXIC USER
359834	ENGINEOS INC	40 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
377340	EUGENE OS BIOSYSTEMS INC	1365 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
333919	EXODUS COMMUNICATION	580 WINTER ST.	WALTHAM	PLANT	AQ SYNTHETIC MINOR W/RESTR PTE < OR = 25% OF MAJ
367872	EXXONMOBIL OIL CORP	1335 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
367872	EXXONMOBIL OIL CORP	1335 MAIN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
367872	EXXONMOBIL OIL CORP	1335 MAIN ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
367872	EXXONMOBIL OIL CORP	1335 MAIN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
327443	FIRE CONTROL INSTRUMENTS	301 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
270937	FOSTER MILLER	195 BEAR HILL RD.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
28475	FOSTER MILLER	360 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
28475	FOSTER MILLER INC	350 SECOND AVE.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
28475	FOSTER MILLER INC	332 350 358 360 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
28475	FOSTER MILLER INC	195 BEAR HILL RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
270937	FOSTER MILLER INC	195 BEAR HILL RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
283333	FOSTER MILLER INC	303 BEAR HILL RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
283333	FOSTER MILLER INC	303 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
321234	FRASCO PRINTING INC	160 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
321234	FRASCO PRINTING INC	160 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
329009	GELTEX PHARMACEUTICALS INC	153 SECOND AVE.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
329009	GELTEX PHARMACEUTICALS INC	153 SECOND AVE.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ



DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
329009	GELTEX PHARMACEUTICALS INC	153 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
53349	HARDRIC LABORATORIES INC	1490 MAIN ST.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
323158	HEMP HILL DRILLING & BLASTING	50 BEAR HILL RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
52883	HOBBS BROOK OFFICE	255 WYMAN ST.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
298501	HOMESTEAD VILLAGE GUEST STUDIOS	52 FOURTH AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
289785	HYSTER NEW ENGLAND INC	358 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
30235	I P L SYSTEMS INC	360 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
204625	IMMULOGIC PHARM CORP	610 LINCOLN ST.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
204625	IMMULOGIC PHARMACEUTICAL CORP	610 LINCOLN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
204625	IMMULOGIC PHARMACEUTICAL CORP	610 LINCOLN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
204625	IMMULOGIC PHARMACEUTICAL CORP	610 LINCOLN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
204625	IMMULOGIC PHARMACEUTICAL CORP	610 LINCOLN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
204625	IMMULOGIC PHARMACEUTICAL CORPORATIONS	610 LINCOLN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
251633	INTERFLUX	230 SECOND AVE.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251633	INTERFLUX	230 SECOND AVE.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251633	INTERFLUX	230 SECOND AVE.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
251633	INTERFLUX	230 SECOND AVE.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
283560	KWIK KOPY PRINTING	292 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
283560	KWIK KOPY PRINTING	292 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
283560	KWIK KOPY PRINTING 426	292 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
283560	KWIK KOPY PRINTING 426	292 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
295139	LERNER PROCESSING	211 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
215026	M A COM OMNI SPECTRA INC	84 FOURTH AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
338261	MASSACHUSETTS GENERAL IMAGING WALTHAM	40 SECOND AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
327305	MASSACHUSETTS MEDICAL SOCIETY	860 WINTER ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
360160	MATRIX TECHNOLOGIES CORP	303 BEAR HILL RD.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
251702	MICROS SYSTEMS	335 BEAR HILL RD.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251702	MICROS SYSTEMS	335 BEAR HILL RD.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
251702	MICROS SYSTEMS	335 BEAR HILL RD.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
251702	MICROS SYSTEMS	335 BEAR HILL RD.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
367872	MOBIL 10238	1335 MAIN ST.	WALTHAM	FULDSP	FUEL DISPENSER STAGEII
330395	MOSAIC TECHNOLOGIES	303 BEAR HILL RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
228869	MULTISOURCE TECH CORP	20 FOX RD.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	TURRPT	LARGE QUANTITY TOXIC USER
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	PLANT	RES APPLICATION APPROVED
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	PLANT	RES OR SYNTHETIC MINOR W/ PTE <MAJ & >80% OF MAJ
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	PLANT	RES APPLICATION APPROVED
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	PLANT	RES OR SYNTHETIC MINOR W/ PTE <MAJ & >80% OF MAJ
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
376678	POLAROID CORP DBA	1265 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
376678	POLAROID CORP DBA	1265 MAIN ST.	WALTHAM	PLANT	FY94 AQ OPERATING PERMIT FEE BETWEEN \$8000-\$8999
376678	POLAROID CORP DBA	1265 MAIN ST.	WALTHAM	TURRPT	LARGE QUANTITY TOXIC USER
376678	POLAROID CORP DBA	1265 MAIN ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
376355	POLAROID CORP DBA	850 - 920 WINTER ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
374359	PRAECIS PHARMACEUTICALS	830 WINTER ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
374359	PRAECIS PHARMACEUTICALS	830 WINTER ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
374359	PRAECIS PHARMACEUTICALS	830 WINTER ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
374359	PRAECIS PHARMACEUTICALS	830 WINTER ST.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
338821	SIERRA SUITES HOTEL	32 FOURTH AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
274787	SUMMERFIELD SUITES HOTEL	54 FOURTH AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
251692	SURGI CARE	150 BEAR HILL RD.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251692	SURGI CARE	150 BEAR HILL RD.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
251692	SURGI CARE	150 BEAR HILL RD.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251692	SURGI CARE	150 BEAR HILL RD.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
251710	SURGI MEDIX	150 BEAR HILL RD.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251710	SURGI MEDIX	150 BEAR HILL RD.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
251710	SURGI MEDIX	150 BEAR HILL RD.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251710	SURGI MEDIX	150 BEAR HILL RD.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
338799	SYNTONIX PHARMACEUTICALS INC	9 FOURTH AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
34070	T R W CUSTOMER SERVICE DIV	290 SECOND AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
270935	TECOGEN	45 FIRST AVE.	WALTHAM	PLANT	AQ SYNTHETIC MINOR W/RESTR PTE < OR = 25% OF MAJ
270935	TECOGEN INC	45 FIRST AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
270935	TECOGEN INC	45 FIRST AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
270935	TECOGEN INC	45 FIRST AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR WASTE OIL/PCBS
270935	TECOGEN INC	45 FIRST AVE.	WALTHAM	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
285783	THERMO ELECTRON CORPORATION	89 FIRST AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
319679	TYCO ELECTRONICS CORP	1370 MAIN ST.	WALTHAM	PLANT	AQ SYNTHETIC MINOR W/RESTR PTE < OR = 25% OF MAJ
319679	TYCO ELECTRONICS CORP	1370 MAIN ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
319679	TYCO ELECTRONICS CORP	1370 MAIN ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR WASTE OIL/PCBS
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	TURRPT	LARGE QUANTITY TOXIC USER
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
319685	TYCO ELECTRONICS CORP	140 FOURTH AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
319679	TYCO ELECTRONICS CORP	1370 MAIN ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR WASTE OIL/PCBS
319679	TYCO ELECTRONICS CORP	1370 MAIN ST.	WALTHAM	HANDLR	LARGE QUANTITY GENERATOR RCRA HAZARDOUS WASTE

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
319679	TYCO ELECTRONICS CORPORATION	1370 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
251716	UNISYS CORPORATION	335 BEAR HILL RD.	WALTHAM	PLANT	BELOW AQ REGULATED THRESHOLDS
251716	UNISYS CORPORATION	335 BEAR HILL RD.	WALTHAM	DISCH	BELOW IWW REGULATED THRESHOLDS
251716	UNISYS CORPORATION	335 BEAR HILL RD.	WALTHAM	HANDLR	BELOW HW REGULATED THRESHOLDS
251716	UNISYS CORPORATION	335 BEAR HILL RD.	WALTHAM	TURRPT	BELOW TUR REGULATED THRESHOLDS
130355	VERIZON LABORATORIES INC	40 SYLVAN RD.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
130355	VERIZON LABORATORIES INC	40 SYLVAN RD.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
130355	VERIZON LABORATORIES INC	40 SYLVAN RD.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
130355	VERIZON LABORATORIES INC	40 SYLVAN RD.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
130355	VERIZON LABORATORIES INC	40 SYLVAN RD.	WALTHAM	PLANT	AQ SYNTHETIC MINOR W/RESTR BUT <OR= 50% OF MAJ
130355	VERIZON LABORATORIES INCORPORATED	40 SYLVAN RD.	WALTHAM	DISCH	MWRA SEWER CONNECTION
309545	WALGREENS #3251	1521 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
309545	WALGREENS #3251	15-21 MAIN ST.	WALTHAM	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE



DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
309545	WALGREENS #3251	1521 MAIN ST.	WALTHAM	DISCH	MWRA SEWER CONNECTION
52684	WESTON HOTEL	70 THIRD AVE.	WALTHAM	PLANT	AQ NATURAL MINOR W/ PTE < OR = 25% OF MAJ
327699	THE WESTON HOTEL	70 THIRD AVE.	WALTHAM	DISCH	MWRA SEWER CONNECTION
318657	CENTER STREET SAS LLC	21 CENTER ST.	WESTON	GROUND	GROUNDWATER MINOR
326322	JERICHO VILLAGE APARTMENTS	JERICHO RD.	WESTON	GROUND	GROUNDWATER MAJOR
367882	EXXONMOBIL OIL CORP	88 BOSTON POST RD.	WESTON	HANDLR	SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
367882	EXXONMOBIL OIL CORP	88 BOSTON POST RD.	WESTON	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
367882	EXXONMOBIL OIL CORP	88 BOSTON POST RD.	WESTON	HANDLR	SMALL QUANTITY GENERATOR WASTE OIL/PCBS
367882	EXXONMOBIL OIL CORP	88 BOSTON POST RD.	WESTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
367882	EXXONMOBIL OIL CORP	88 BOSTON POST RD.	WESTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
326322	JERICHO VILLAGE APARTMENTS	JERICHO RD.	WESTON	GROUND	GROUNDWATER MAJOR
367882	MOBIL 12104	88 BOSTON POST RD.	WESTON	FULDSP	FUEL DISPENSER STAGEII
117425	NOBB HILL PRESS INC	474 BOSTON POST RD.	WESTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE

DEP FACILITY NUMBER	FACILITY NAME	STREET ADDRESS	TOWN	PERMITTED ACTIVITY	ACTIVITY CLASS
117425	NOBB HILL PRESS INC	474 BOSTON POST RD.	WESTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
116753	PRIME NATIONAL PUBLISHING CORP	470 BOSTON POST RD.	WESTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE
39976	WESTON TRANSFER STATION	CHURCH ST.	WESTON	TRSTN	SMALL TRANSFER STATION
334997	WESTON VETERINARY CLINIC	152 BOSTON POST RD.	WESTON	HANDLR	VERY SMALL QUANTITY GENERATOR RCRA HAZARDOUS WASTE

**UNDERGROUND STORAGE TANKS WITHIN CAMBRIDGE WATER SUPPLY PROTECTION AREAS**

<b>FACILITY NAME</b>	<b>ADDRESS</b>	<b>TOWN</b>	<b>DESCRIPTION</b>	<b>CAPACITY (GAL)</b>	<b>CONTENTS</b>
A & E SERVICE STATION	199 CONCORD AVE.	CAMBRIDGE	GAS STATION	10000	GASOLINE
A & E SERVICE STATION	199 CONCORD AVE.	CAMBRIDGE	GAS STATION	10000	GASOLINE
A & E SERVICE STATION	199 CONCORD AVE.	CAMBRIDGE	GAS STATION	10000	DIESEL
FRESH POND GAS	480 CONCORD AVE.	CAMBRIDGE	GAS STATION	8000	GASOLINE
FRESH POND GAS	480 CONCORD AVE.	CAMBRIDGE	GAS STATION	8000	GASOLINE
FRESH POND GAS	480 CONCORD AVE.	CAMBRIDGE	GAS STATION	8000	GASOLINE
FRESH POND GULF	260 LEXINGTON AVE.	CAMBRIDGE	GAS STATION	5000	GASOLINE
FRESH POND GULF	260 LEXINGTON AVE.	CAMBRIDGE	GAS STATION	5000	GASOLINE
FRESH POND GULF	260 LEXINGTON AVE.	CAMBRIDGE	GAS STATION	5000	GASOLINE
MOBIL OIL	343 FRESH POND PKWY	CAMBRIDGE	GAS STATION	12000	GASOLINE
MOBIL OIL	343 FRESH POND PKWY	CAMBRIDGE	GAS STATION	10000	GASOLINE
MOBIL OIL	343 FRESH POND PKWY	CAMBRIDGE	GAS STATION	10000	GASOLINE

FACILITY NAME	ADDRESS	TOWN	DESCRIPTION	CAPACITY (GAL)	CONTENTS
MOBIL OIL	343 FRESH POND PKWY	CAMBRIDGE	GAS STATION	1000	WASTE OIL
MT AUBURN AUTO SERVICE INC	605 MOUNT AUBURN ST.	CAMBRIDGE	GAS STATION	8000	GASOLINE
MT AUBURN AUTO SERVICE	605 MOUNT AUBURN ST.	CAMBRIDGE	GAS STATION	8000	GASOLINE
NICK'S SERVICE STATION	587 MOUNT AUBURN ST.	CAMBRIDGE	GAS STATION	12000	GASOLINE
NICK'S SERVICE STATION	587 MOUNT AUBURN ST.	CAMBRIDGE	GAS STATION	10000	GASOLINE
NICK'S SERVICE STATION	587 MOUNT AUBURN ST.	CAMBRIDGE	GAS STATION	500	WASTE OIL
SANCTA MARIA NURSING FACILITY	799 CONCORD AVE.	CAMBRIDGE	NURSING HOME	1500	DIESEL
SHELL SERVICE STATION	603 CONCORD AVE.	CAMBRIDGE	GAS STATION	10000	GASOLINE
SHELL SERVICE STATION	603 CONCORD AVE.	CAMBRIDGE	GAS STATION	10000	GASOLINE
SHELL SERVICE STATION	603 CONCORD AVE.	CAMBRIDGE	GAS STATION	10000	GASOLINE
SHELL SERVICE STATION	603 CONCORD AVE.	CAMBRIDGE	GAS STATION	500	FUEL OIL
SUNOCO	515 CONCORD AVE.	CAMBRIDGE	GAS STATION	8000	GASOLINE

FACILITY NAME	ADDRESS	TOWN	DESCRIPTION	CAPACITY (GAL)	CONTENTS
SUNOCO	515 CONCORD AVE.	CAMBRIDGE	GAS STATION	8000	GASOLINE
SUNOCO	515 CONCORD AVE.	CAMBRIDGE	GAS STATION	8000	GASOLINE
SUNOCO	515 CONCORD AVE.	CAMBRIDGE	GAS STATION	4000	DIESEL
SUNOCO	515 CONCORD AVE.	CAMBRIDGE	GAS STATION	550	FUEL OIL
SUNOCO	515 CONCORD AVE.	CAMBRIDGE	GAS STATION	550	WASTE OIL
US PETROLEUM	297 CONCORD AVE.	CAMBRIDGE	GAS STATION	20000	GASOLINE
BOMAR SERVICE CENTER INC	ROUTE 128 NORTHBOUND	LEXINGTON	GAS STATION	10000	GASOLINE
BOMAR SERVICE CENTER INC	ROUTE 128 NORTHBOUND	LEXINGTON	GAS STATION	10000	GASOLINE
BOMAR SERVICE CENTER INC	ROUTE 128 NORTHBOUND	LEXINGTON	GAS STATION	10000	GASOLINE
BOMAR SERVICE CENTER INC	ROUTE 128 NORTHBOUND	LEXINGTON	GAS STATION	10000	GASOLINE
RAYTHEON CO	141 SPRING ST.	LEXINGTON	INDUSTRIAL	4000	GASOLINE
SHELL SERVICE STATION	286 LINCOLN ST.	LEXINGTON	GAS STATION	10000	GASOLINE

FACILITY NAME	ADDRESS	TOWN	DESCRIPTION	CAPACITY (GAL)	CONTENTS
SHELL SERVICE STATION	286 LINCOLN ST.	LEXINGTON	GAS STATION	10000	GASOLINE
SHELL SERVICE STATION	286 LINCOLN ST.	LEXINGTON	GAS STATION	10000	GASOLINE
XEROX CORP	191 SPRING ST.	LEXINGTON	OTHER	10000	FUEL OIL
XEROX CORP	191 SPRING ST.	LEXINGTON	OTHER	10000	FUEL OIL
DOHERTY'S GARAGE INC	161 LINCOLN RD.	LINCOLN	GAS STATION	15000	GASOLINE
ROBERT J TRACEY	131 CAMBRIDGE TURNPIKE	LINCOLN	GAS STATION	6000	GASOLINE
ROBERT J TRACEY	131 CAMBRIDGE TURNPIKE	LINCOLN	GAS STATION	6000	GASOLINE
ROBERT J TRACEY	131 CAMBRIDGE TURNPIKE	LINCOLN	GAS STATION	2000	GASOLINE
AUTOMATIC DATA PROCESSING INC	225 SECOND AVE.	WALTHAM	OTHER	10000	GASOLINE
BAY COLONY CORPORATE CENTER	1000 WINTER ST.	WALTHAM	OTHER	1000	DIESEL
MOBIL	1335 MAIN ST.	WALTHAM	GAS STATION	10000	GASOLINE
MOBIL	1335 MAIN ST.	WALTHAM	GAS STATION	8000	GASOLINE

FACILITY NAME	ADDRESS	TOWN	DESCRIPTION	CAPACITY (GAL)	CONTENTS
MOBIL	1335 MAIN ST.	WALTHAM	GAS STATION	6000	GASOLINE
MOBIL	1335 MAIN ST.	WALTHAM	GAS STATION	6000	DIESEL
MOLA'S EXXON	1455 TRAPELO RD.	WALTHAM	GAS STATION	8000	GASOLINE
MOLA'S EXXON	1455 TRAPELO RD.	WALTHAM	GAS STATION	6000	GASOLINE
MOLA'S EXXON	1455 TRAPELO RD.	WALTHAM	GAS STATION	4000	GASOLINE
MOLA'S EXXON	1455 TRAPELO RD.	WALTHAM	GAS STATION	1000	WASTE OIL
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	20000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	20000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	20000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	20000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	20000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	20000	HAZARDOUS



FACILITY NAME	ADDRESS	TOWN	DESCRIPTION	CAPACITY (GAL)	CONTENTS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	12000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
POLAROID CORP	1265 MAIN ST.	WALTHAM	INDUSTRIAL	10000	HAZARDOUS
BELMONT AUTO CLINIC	180 BELMONT ST.	WATERTOWN	GAS STATION	6000	GASOLINE
BELMONT AUTO CLINIC	180 BELMONT ST.	WATERTOWN	GAS STATION	6000	GASOLINE

FACILITY NAME	ADDRESS	TOWN	DESCRIPTION	CAPACITY (GAL)	CONTENTS
BELMONT AUTO CLINIC	180 BELMONT ST.	WATERTOWN	GAS STATION	6000	GASOLINE
BELMONT AUTO CLINIC	180 BELMONT ST.	WATERTOWN	GAS STATION	500	WASTE OIL
KENDAL GREEN SERVICE CENTER	290 NORTH AVE.	WESTON	GAS STATION	10000	GASOLINE
KENDAL GREEN SERVICE CENTER	290 NORTH AVE.	WESTON	GAS STATION	10000	GASOLINE
KENDAL GREEN SERVICE CENTER	290 NORTH AVE.	WESTON	GAS STATION	5000	GASOLINE
MOBIL OIL CORP	88 BOSTON POST RD.	WESTON	GAS STATION	12000	GASOLINE
MOBIL OIL CORP	88 BOSTON POST RD.	WESTON	GAS STATION	10000	GASOLINE
MOBIL OIL CORP	88 BOSTON POST RD.	WESTON	GAS STATION	10000	GASOLINE
MOBIL OIL CORP	88 BOSTON POST RD.	WESTON	GAS STATION	1000	WASTE OIL
WESTON GOLF CLUB GROUNDS DEPT	275 MEADOWBROOK RD.	WESTON	OTHER	2000	GASOLINE
WESTON GOLF CLUB GROUNDS DEPT	275 MEADOWBROOK RD.	WESTON	OTHER	1000	DIESEL

For more information on underground storage tanks, visit the Massachusetts Department of Fire Services web site: <http://www.state.ma.us/dfs/ust/ustHome.htm>

Note: This appendix includes only those facilities within the water supply protection area(s) that meet state reporting requirements and report to the appropriate agencies. Additional facilities located within the water supply protection area(s) should be considered in local drinking water source protection planning.

**APPENDIX B – Table of Tier Classified Oil and/or Hazardous Material Sites within Cambridge Water Supply Protection Areas**

DEP’s datalayer depicting oil and/or hazardous material (OHM) sites is a statewide point data set that contains the approximate location of known sources of contamination that have been both reported and classified under Chapter 21E of the Massachusetts General Laws. Location types presented in the layer include the approximate center of the site, the center of the building on the property where the release occurred, the source of contamination, or the location of an on-site monitoring well. Although this assessment identifies OHM sites near the source of your drinking water, the risks to the source posed by each site may be different. The kind of contaminant and the local geology may have an effect on whether the site poses an actual or potential threat to the source.

The DEP’s Chapter 21E program relies on licensed site professionals (LSPs) to oversee cleanups at most sites, while the DEP’s Bureau of Waste Site Cleanup (BWSC) program retains oversight at the most serious sites. This privatized program obliges potentially responsible parties and LSPs to comply with DEP regulations (the Massachusetts Contingency Plan – MCP), which require that sites within drinking water source protection areas be cleaned up to drinking water standards.

For more information about the state’s OHM site cleanup process to which these sites are subject and how this complements the drinking water protection program, please visit the BWSC web page at <http://www.state.ma.us/dep/bwsc>. You may obtain site -specific information two ways: by using the BWSC Searchable Sites database at <http://www.state.ma.us/dep/bwsc/sitellst.htm>, or you may visit the DEP regional office and review the site file. These files contain more detailed information, including cleanup status, site history, contamination levels, maps, correspondence and investigation reports, however you must call the regional office in order to schedule an appointment to view the file.

The table below contains the list of Tier Classified oil and/or Hazardous Material Release Sites that are located within your drinking water source protection area.

**Table 1:** Bureau of Waste Site Cleanup Tier Classified Oil and/or Hazardous Material Release Sites (Chapter 21E Sites) - Listed by Release Tracking Number (RTN)

RTN	Release Site Address	Town	Contaminant Type
3-0016793	Convergence Of Rtes 2, 16 and 3	Cambridge	Oil
3-0002382	480 Concord Avenue	Cambridge	?
3-0001320	343 Fresh Pond Parkway	Cambridge	?
3-0018589	Wheeler St And Fresh Pond Parkway	Cambridge	Oil And Hazardous Material
3-0002920	260 Lexington Avenue	Cambridge	?
3-0018094	26 Smith Place	Cambridge	Hazardous Material
3-0000269	671 Concord Street	Cambridge	Oil
3-0002594	555 Concord Avenue	Cambridge	?
3-0013222	Wheeler & Concord Streets	Cambridge	Oil
3-0000089	603 Concord Avenue	Cambridge	?

<b>RTN</b>	<b>Release Site Address</b>	<b>Town</b>	<b>Contaminant Type</b>
3-0015303	603 Concord Avenue	Cambridge	Oil
3-0000959	445 Concord Avenue	Cambridge	Oil
3-0019196	201 Vassar Street	Cambridge	Oil
3-0013797	605 Mt Auburn Street	Cambridge	Oil
3-0016604	605 Mt Auburn Street	Cambridge	Oil
3-0002177	191 Concord Avenue	Cambridge	?
3-0013583	450 Concord Avenue	Cambridge	Hazardous Material
3-0001213	1-95 North/Route 2A	Lexington	Oil
3-0011633	286 Lincoln Street	Lexington	Oil
3-0010293	14 Green Street	Waltham	Oil
3-0000582	Jones Rd/Stony Brook	Waltham	Oil And Hazardous Material
3-0013311	175 Wyman Street	Waltham	Hazardous Material
3-0001000	1455 Trapelo Road	Waltham	Oil
3-0003920	39 Warren Avenue	Weston	?

For more location information, please see the attached map. The map lists the release sites by Release Tracking Number (RTN).